


SECTION


SCALE 1/4" = 1'-0"

MECHANICAL VENTILATION REQUIREMENT:
 EXHAUST FAN SHALL OPERATE AT MINIMUM OF 700 CFM WHEN BUILDING IS OCCUPIED
 CARBON MONOXIDE SENSOR SHALL BE USED TO CONTROL FAN SO
 THAT AIR FLOW RATE IS INCREASED TO 10,000 CFM WHEN CARBON MONOXIDE
 IS DETECTED IN BUILDING.

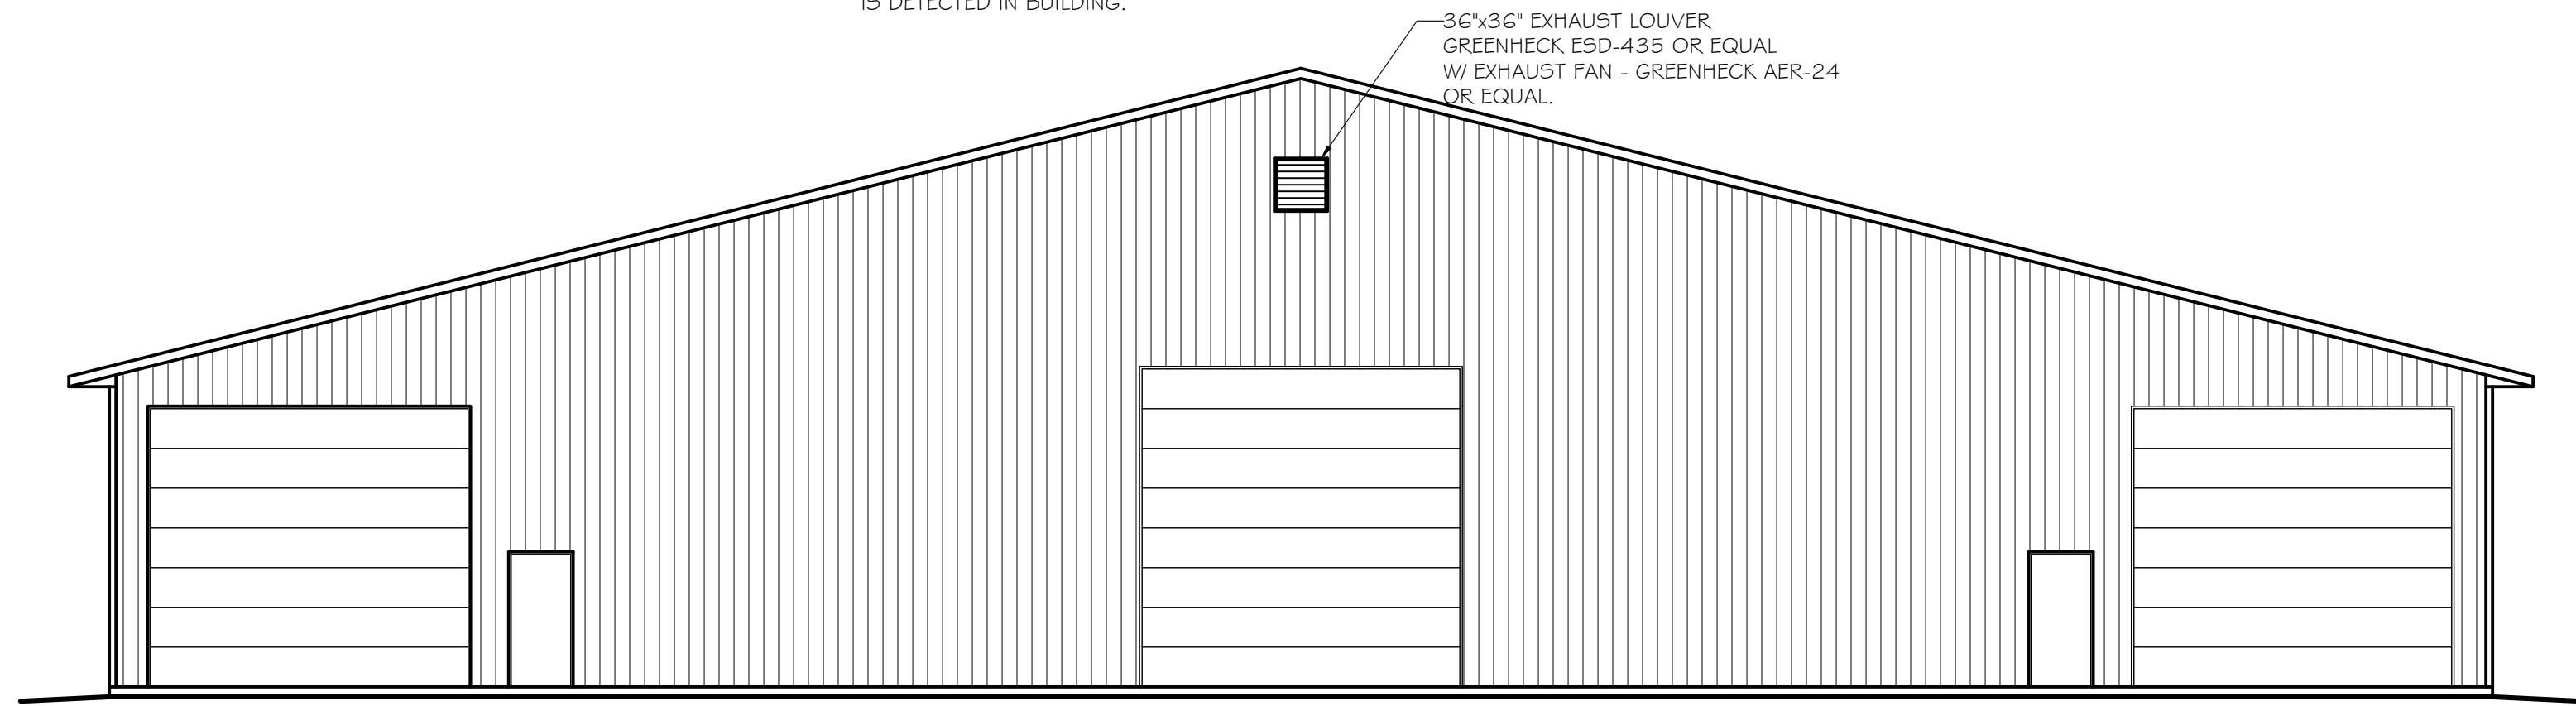

END ELEVATION

SCALE 1/8" = 1'-0"

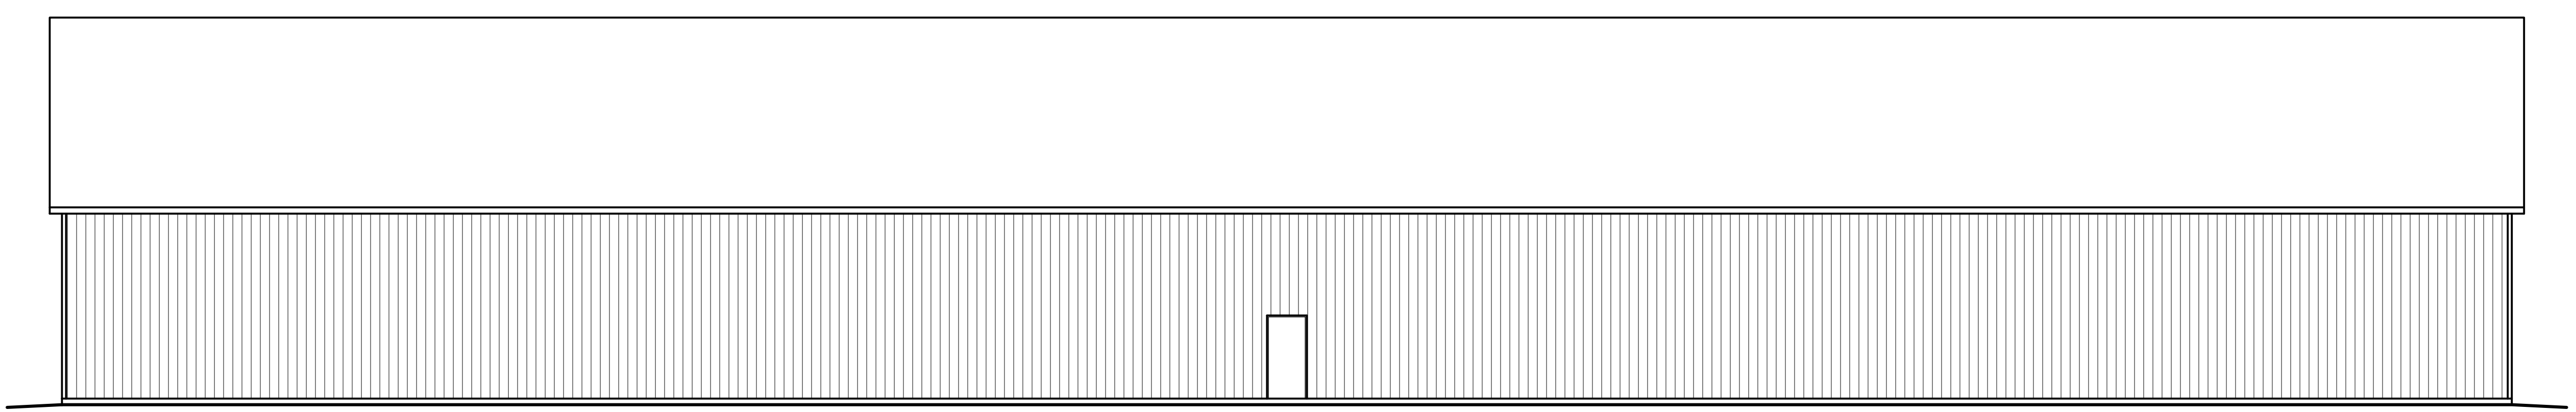

SIDE ELEVATION

SCALE 1/8" = 1'-0"

